



SUPPORTING DOCUMENT

PLAN REVIEW GUIDE

RESIDENTIAL CONSTRUCTION

**THIS CHECKLIST IS PART OF THE APPROVED SET OF PLANS.
DO NOT REMOVE, SEPARATE OR DETACH ANY DOCUMENTS**

Part 1 – Climatic and Geographic Design Criteria - IRC Table R301.2 (1)

Ground Snow Load	Wind Speed/3 Sec Gust	Seismic Design Category	Weathering	Frost Line Depth	Termite	Decay	Winter Design Temp	Ice Shield Underlayment Req'd	Flood Hazard	Air Freezing Index	Mean Annual Temp
30 lbs	85mph/ 38mph 110 mph ultimate	D2	Moderate	12"	Slight to Moderate	Moderate to Severe	26 ⁰ F	No	(a) 1980, (b) 1980)	148	51.4 ⁰ F

Part 2 – Building Code Design Data

- 2012 International Residential Code (IRC), WAC 51-51-003
- 2012 Washington State Energy Code (WSEC), WAC 51-11R
- 2012 Uniform Plumbing Code (UPC), WAC 51-56
- 2012 International Mechanical Code (IMC) and 2012 International Fuel Gas Code (IFGC), WAC 51-52-003

Part 3 – General Code Provisions

The following are common code requirements which apply to residential projects. The numbered items on the following pages are associated with the above referenced codes, as adopted and amended by Kitsap County. This guide is intended to provide basic, helpful information only, and shall not be construed as an all-inclusive list of code requirements.

In order to aid with the transition from the 2009 International Residential Code to the 2012 International Residential Code, substantial code changes or differences are in **BOLD TYPE**.

FLOOR PLAN

1. **EGRESS WINDOWS:** IRC R310.1. Basements, habitable attics, and every sleeping room shall have at least one operable emergency escape and rescue opening. Windows shall have a minimum net clear openable area of 5.7 square feet, or, may be a minimum of 5.0 square feet for grade floor openings. The minimum clear opening height shall be 24", and the minimum clear opening width shall be 20". **The window shall have a finished sill height at 44" or less measured from the finished floor to the bottom of the clear opening.** Emergency escape and rescue openings shall be operational from the inside of the room without

the use of keys, tools, or special knowledge. Window wells shall be provided when egress windows have a finished sill height below the adjacent ground elevation. The well shall allow the window to be fully opened and provide a minimum accessible net clear opening of 9 square feet, with a minimum dimension of 36". Window wells with a vertical depth of more than 44" shall be equipped with a permanent ladder or steps. See Page 21, *Emergency Escape and Rescue Windows* for additional information.

2. **SMOKE ALARMS:** IRC Section R314. A smoke alarm listed in accordance with UL217 shall be installed in:



1. Each sleeping room, including each bedroom, bonus room, and other habitable rooms that could potentially be sleeping rooms that contain an intervening door that can be closed to separate the room from areas otherwise provided with smoke alarms;
 2. Outside each separate sleeping area in the immediate vicinity of the bedrooms;
 3. Each additional story of the dwelling including basements (but excluding crawl spaces and uninhabitable attics.); In dwelling units with split levels and without an intervening door between the adjacent levels, a smoke alarm installed on the upper level shall suffice for the adjacent lower level provided that the lower level is less than one full story below the upper level;
 4. **In napping areas in a family home child care.** When more than one smoke alarm is required to be installed within an individual dwelling unit, the alarm devices shall be interconnected in such a manner that the actuation of one alarm will activate all of the alarms in the individual unit. Interconnection and hardwiring is not required in existing buildings if the alterations do not result in the removal of wall or ceiling finishes unless there is a basement, attic, or crawl space which could provide access for hardwiring and interconnection without removing the interior finish. **Physical interconnection of smoke alarms shall not be required where listed wireless alarms are installed and all alarms sound upon activation of one alarm.** Note: Habitable rooms such as dens, libraries and offices that are provided with built in features that establish the specific use of the room as something other than for sleeping, and do not contain clothes closets, need not be considered a sleeping room.
3. **CARBON MONOXIDE ALARMS: IRC Section 315** An approved carbon monoxide alarm listed with UL 2034 shall be installed outside of each separate sleeping area in the immediate vicinity of the bedroom **and on each level. The exemptions are:**
- **Work involving only the exterior of the dwelling, such as the replacement of roofing or siding, or the addition or replacement of windows or doors, or the addition of a porch or deck or electrical permits, are exempt.**
 - **Installation, alteration or repairs of non-fuel burning plumbing or mechanical systems are exempt.**
 - **Owner-occupied single-family residences legally occupied prior to July 26, 2009.**
 - **Combined carbon monoxide and smoke alarms are permitted.**
4. **SAFETY GLAZING:** IRC R308.4. All glass located in an area considered hazardous must be safety glazed:
- a. Glazing in all fixed and operable panels of swinging, sliding and bifold doors, except decorative glazing and glazed openings
 - b. Glazing adjacent to a door where either vertical edge is within a 24" arc of the door in a closed position and whose bottom edge is less than 60" above the floor or walking surface. Exceptions: decorative glazing; an intervening wall or permanent barrier is between the door and the glazing; glazing is in a wall on the latch side of the door and perpendicular to the plane of the door in a closed position; glazing adjacent to a door giving access to a closet which is less than 3' in depth; and glazing adjacent to the fixed panel of a patio door.
 - c. Glazing. that meet all of the following conditions:
 - i. Exposed area of an individual pane is greater than 9 square feet. *and*
 - ii. Exposed bottom edge is less than 18" above the floor. *and*
 - iii. Exposed top edge is greater than 36" above the floor. *and*
 - iv. 1 or more walking surfaces are within 36" horizontally of the plane of the glazing.

Exceptions: Decorative glazing; a rail at least 1½" high and capable of withstanding a horizontal force at least 50 pounds per linear foot without contacting the glass is installed in front of the glazing 34" to 38" above the walking surface, or outboard panes in insulating glass units and other multiple glazed panels when the bottom edge of the glass is 25' or more above grade, roof, walking surfaces or other horizontal surface adjacent to the glass exterior.
 - d. Glazing in railings regardless of area or height above a walking surface.



- e. **Glazing in walls, enclosures or fences containing a tub, shower, spa, hot tub, whirlpool, sauna, steam room enclosures and indoor or outdoor swimming pools where the bottom is less than 60" above the walking surface. Exception: Glazing more than 60" measured horizontally and in a straight line, from the waters edge of a bathtub, hot tub, spa, whirlpool, or swimming pool..**
- f. **Glazing where the bottom exposed edge of the glazing is less than 36" above the plane of the adjacent walking surface of stairways, landings between flights of stairs and ramps shall be considered a hazardous location.** Exceptions: A rail (as described in the decorative glazing exception), is installed or glazing 36" or more measured horizontally from the walking surface.
- g. Glazing adjacent to the landing at the bottom of a stairway where the glazing is less than 36" above the landing and within 60" horizontally of the bottom tread. Exception: The glazing is protected by a guard complying with Section 312 and the plane of the glass is more than 18" from the guard.

5. **EXHAUST FANS:** IRC M1507, IMC 501 Source specific exhaust ventilation is required in each kitchen, bathroom, water closet, laundry room, indoor swimming pool, spa, and other rooms where water vapor or cooking odor is produced. Exhaust fans providing source specific ventilation shall have a minimum fan flow rating not less than 50 cfm at 0.25 inches water gauge for bathrooms, laundries, or similar rooms and 100 cfm at 0.25 inches water gauge for kitchens.

The air removed by every mechanical exhaust system shall be discharged outdoors. Air shall not be exhausted into an attic, soffit, ridge vent, or crawl space. *See the energy section of this checklist for additional requirements.*

6. **CLOTHES DRYERS:** IRC Sections M1502, G2439, IMC 504. Clothes dryer exhaust ducts shall terminate outside the building at least 3' away from any openings and be equipped with a back draft damper. Exhaust ducts shall be constructed of minimum 0.016-inch-thick rigid metal ducts, having smooth interior surfaces with joints running in the direction of air flow. Ducts shall not be connected with sheet metal screws or other fasteners which could obstruct the flow.

Exhaust ducts shall be supported at 4' intervals and secured in place. Approved (UL 2158A) transition duct of not more than 8' in length may be used within a dwelling, provided they are not concealed within construction. Duct length shall not exceed a total combined vertical and horizontal length of 35' from the connection of the transition duct from the dryer to the outlet terminal. The maximum length of the duct shall be reduced in accordance with Table M1502.4.4.1, except the manufacturer's instructions may prevail if the instructions are provided to the inspector at the time of the concealment inspection. No screens shall be installed at the duct termination. Where the duct is concealed within the building construction, the equivalent length of the exhaust duct shall be identified on a permanent label or tag located within 6' of the exhaust duct connection.

Table M1502.4.4.1 Dryer Exhaust Duct Fitting Equivalent Length

Exhaust Duct Fitting Type	Equivalent Length
4" radius mitered 45° elbow	2' 6"
4" radius mitered 90° elbow	5'
6" radius smooth 45° elbow	1'
6" radius smooth 90° elbow	1' 9"
8" radius smooth 45° elbow	1'
8" radius smooth 90° elbow	1' 7"
10" radius smooth 45° elbow	9'
10" radius smooth 90° elbow	1' 6"

7. **RANGE HOOD:** IRC Section M1503, M1901. The vertical distance between the cooking top of a domestic range and unprotected combustible material shall not be less than 30". Reduced clearances may be permitted in accordance with the listing and labeling of the range hoods or appliances. Commercial cooking equipment shall not be installed within dwelling units; cooking appliances shall be listed and labeled as household-type appliances for domestic use.

8. **WATER CLOSET CLEARANCES:** IRC Section R305, Figure 307.1. Water closets shall be located in a clear space not less than 30" in width, and not closer than 15" from the center of the fixture to a wall or other side barrier such as a tub. The clear space in front of the water closet shall be at least 21". **The ceiling height above the**



- fixture shall be such that the fixture is capable of being used for its intended purpose.
9. **SHOWER AREAS:** IRC Figure 307.1, R305, R307. Showers shall be minimum 30"x 30" and have a minimum 24" clearance in front of the opening, and at least 6' 8" clearance above the shower floor or tub. A non-absorbent wall finish shall be provided to a height of not less than 6 feet above the shower floor.
 10. **CHIMNEYS & FIREPLACES:** IRC Chapter 10. Factory-built chimneys and fireplaces shall be certified & tested in accordance with UL 127, listed and labeled, and shall be installed and terminated in accordance with the manufacturer's installation instructions. Masonry or concrete fireplaces shall be constructed in accordance with IRC Chapter 10 & Figure R1001.1. and to be certified in accordance with Washington State Building Code Standard 31-2
 11. **TIGHT-FITTING DOORS (FIREPLACE):** IRC R1001.7.1. Solid fuel burning appliances and fireplaces shall be provided with tight-fitting glass or metal doors, or a flue draft induction fan or as approved for minimizing back-drafting. An outside source of combustion air shall be ducted to the firebox with ducts at least 6 square inches.
 12. **FIREPLACE HEARTH EXTENSION:** IRC 1001.10. An approved noncombustible hearth must extend at least 16" from the front of, and at least 8" beyond each side of the fireplace opening. Where the fireplace opening is 6 square feet or larger, the hearth extension shall extend at least 20" in front of, and at least 12" beyond each side of the fireplace opening.
 13. **CLEARANCE TO COMBUSTIBLES:** IRC 1003.18, 1001.11. When masonry chimneys are built within a structure, a 2" clearance to combustible material is required. When a chimney is placed on the exterior of the structure, a 1" clearance is allowed. Combustible material shall not be placed within 6" of fireplace opening. No combustible material placed within 12" of the fireplace opening (such as mantles or decorative fireplace surrounds) shall project more than 1/8" of each 1" clearance from the opening. See IRC Chapter 10 for additional requirements.
 14. **APPLIANCE LOCATIONS:** IRC G2406.2. Fuel burning appliances shall not be installed in a sleeping room, bathroom, toilet room, or closet. *Exception: direct vent appliances (see IRC Section G2406.2 for additional exceptions).*
 15. **APPLIANCES LOCATED IN GARAGE:** IRC M1307.3. Appliances located in a garage or carport or any other location subject to vehicle damage shall be protected by approved barriers. Appliances having an ignition source shall be elevated so that the source of ignition is at least 18" above the floor in garages and in any room that opens to the garage **unless listed as flammable vapor ignition resistant.** Appliances designed to be fixed in position shall be fastened or anchored in an approved method.
 16. **WATER HEATER:** IRC M1307.2; UPC Chapter 5; WSEC 504.2.1. Water heaters shall be anchored or strapped to resist horizontal displacement due to earthquake motion. Strapping shall be at points within the upper one-third and lower one-third of the appliance and shall be at least 4" away from the controls. Where water heaters are installed in locations where leakage of the tank or connections can cause damage, a watertight pan of corrosion-resistant materials shall be installed beneath the water heater with a minimum 3/4" diameter drain to an approved location. Temperature and pressure relief valves shall be drained to outside, except that replacement water heaters shall only be required to provide a drain pointing downward from the relief valve to extend between 24" and 6" from the floor with no additional floor drain. Drain may not be trapped and must terminate no more than 24" nor less than 6" from the ground and shall not be threaded. All electric hot water heaters shall be placed on an R-10 pad when located in an unheated space or on a concrete floor. A thermal expansion (compression) tank shall be installed on water heater tanks.
 17. **L.P.G. (PROPANE) APPLIANCES:** IFGC 303.2 and 303.3 prohibits appliances from being installed in a hazardous location, which is any location considered to be a fire hazard for flammable vapors, dust, combustible fibers or other highly combustible substances. L.P.G. (heavier than air) containers shall not be installed in a basement, cellar, pit, under-floor space, below grade or similar location where heavier-than-air gas might collect.
L.P.G. tanks shall be installed in accordance with NFPA 58 and IFC Chapter 61 of the 2012. L.P.G. standard shall be NFPA 58.



Typical LPG Tank Setbacks

L.P.G. Tank Size (gal)	Required Setback from Buildings and property lines
< 125	zero, with conditions*
125 to 500	10 feet
500 to 2000	25 feet

*Minimum 5 feet to property lines; building openings; sources of ignition; ventilation air intakes; openings into direct-vent appliances.

18. **BACKFLOW PREVENTORS:** UPC Section 603. Potable water outlets with hose attachments other than water heater drains and clothes washer connections shall be protected by a listed non-removable hose bibb type backflow preventer, or atmospheric vacuum breaker. All cross connections between potable water sources and other systems, such as landscape irrigation systems, hydronic radiant heating systems, swimming pools, etc. shall be equipped with backflow preventers.
19. **GARAGE/DWELLING DOOR:** IRC 302.5.1. Openings from a private garage directly into a room used for sleeping purposes shall not be permitted. Other openings between the garage and residence shall be equipped with solid wood doors not less than 1-3/8" in thickness, solid or honeycomb core steel doors not less than 1-3/8" thick, or 20-minute fire-rated doors **equipped with a self closing device.**
20. **GARAGE/DWELLING SEPARATION, GARAGE FLOOR:** IRC R302.5, R309.1 The garage shall be separated from the residence and its attic area by not less than 1/2" gypsum board applied to the garage side, including garages located less than 3' from a dwelling unit on the same lot. Garages beneath habitable rooms shall be separated from all habitable rooms above by not less than 5/8" Type X gypsum board and shall be installed perpendicular to the ceiling framing and be fastened at 6" o.c. by minimum 1-7/8" 6d coated nails or equivalent drywall screws. Structural members supporting the horizontal separation shall be protected by minimum 1/2" gypsum board (this includes all bearing walls, posts, columns, etc.). Ducts in the garage and ducts penetrating the walls or ceilings separating the dwelling from the garage shall be constructed of a minimum No.26 gage sheet steel or other approved material and shall have no openings in the garage. Openings around vents, pipes, ducts, cables, and wires shall be fire blocked with an approved

material to resist the passage of flame and products of combustion. The garage floor shall be of concrete or other approved noncombustible material, and shall be sloped to facilitate the movement of liquids to a drain or toward the main vehicle entry doorway. A carport (open on at least 2 sides) may have a floor surface of asphalt.

21. **SEPARATION BETWEEN DWELLING UNITS:** IRC R302.3, R302.2. Walls and floors separating dwelling units in two-family dwellings shall not be less than 1-hr fire-resistance construction when tested in accordance with ASTM E 119 or UL 263. Fire-resistant-rated floor-ceiling and wall assemblies shall extend to and be tight against the exterior walls, and wall assemblies shall extend from the foundation to the underside of the roof sheathing. Wall assemblies need not extend through attic spaces when the ceiling is protected by 5/8" Type X gypsum board, an attic draft stop is provided above and along the wall assembly, and the structural frame supporting the ceiling is protected by not less than 1/2" gypsum board. Townhouses shall be separated by either a 1-hour fire-resistance-rated wall assembly at **each** townhouse, or a common 2-hour fire-resistance-rated wall assembly between townhouses, with no plumbing, ducts, or vents in the cavity, tested in accordance with E119 or UL 263. See R302 for details of fire-resistant-rated construction.
22. **FIRE-RESISTANCE OF EXTERIOR WALLS:** IRC Section R302.1 Tables R302.1 & R302.1(2). 1-hr fire-resistive construction is required within 5' of property lines. Openings are not permitted at less than 3' and are limited between 3' and 5'. Projections are allowed to be protected with 1-hour fire-resistance rated construction on the underside when the projection is between 2' and 5' from the property line. Unprotected, detached garages shall be at least 3' away from other residential or accessory buildings. **When equipped throughout with an automatic sprinkler system installed as per Section P2904 clearances can be reduced as per table R302.1(2)**
23. **FLOOR AREA:** IRC Section R304. Dwelling units shall have at least one habitable room with not less than 120 square feet of floor area. Other habitable rooms except kitchens shall have an area of not less than 70 square feet with a minimum dimension of 7' in one direction.
24. **MINIMUM CEILING HEIGHTS:** IRC R305.1 Habitable spaces shall have a ceiling height of not less than 7 feet. Ceilings in basements without



habitable spaces may have a ceiling height of 6'-8" with beams projecting to within 6'-4" of the finished floor. Bathrooms shall have minimum ceiling height of 6'-8" at the front clearance areas of fixtures.

25. **ATTIC ACCESS:** IRC R807.1. Attics which exceed 30 square feet and have a vertical height of 30" or more as measured from the top of the ceiling framing member to the underside of the roof framing members must be provided with an access opening of not less than 22" x 30" and located in a hallway, corridor, or readily accessible location. When the access is located in the ceiling, minimum unobstructed headroom in the attic space shall be 30" at some point above the access measured vertically from the bottom of the ceiling framing members. Attics containing appliances shall be provided with an opening and a clear and unobstructed passageway large enough to allow removal of the largest appliance and with an opening with a minimum dimension of 22" by 30" and maximum passageway of 20' long measured from the opening to the appliance. See M1305.1.3 for additional details.
26. **DOORS & EXITS:** IRC R311.2. **At least one egress door shall be provided in each dwelling unit. The egress door shall be side-hinged, with a minimum clear width of 32" when measured between the face of the door and the stop** (usually a 36" door) and clear height of 78", and that can be opened without the use of a key, tool or special knowledge.
27. **LANDINGS:** IRC R311.3. There shall be a floor or landing on each side of exterior doors with dimensions of at least 36" measured in the direction of travel, and at least the width of the door served. **The floor or landing shall be not more than 1.5" lower than the top of the threshold, Doors may have an exterior landing up to 7 3/4" below the level of the threshold provided the door does not swing over the landing (except that screen and storm doors may);** OR, if not the main exit and there are two or fewer risers, a landing is not required. In addition, an interior door may open at the top of a flight of stairs provided the door does not swing over the top step. Exterior landings may have a slope not to exceed 2% (1" in 48").
28. **GUARDS AND WINDOW FALL PROTECTION:** IRC Section R312. Porches, balconies or raised floor surfaces located more than 30" above the floor or grade below shall have guards not less than 36" in height, including areas enclosed with insect screening, except where guards are required at the open side of stairs, the height may be reduced to 34" above the stair nosings. Guardrails shall be designed such that a sphere 4" diameter cannot pass through, except the triangular opening between a riser, tread and the bottom rail of the guard may be of such size that a sphere 6" cannot pass through. **Window fall protection shall be provided for openable windows located more than 72" above the finished grade or surface below. The lowest part of the clear opening of the window shall be a minimum 24" above the finished floor of the room Exceptions for windows whose openings are within 24" of the finished floor are: The opening will not allow the passage of a 4" diameter sphere; The opening has a window fall prevention device; The opening has a window opening control device. Devices shall comply with ASTM F2090.**
29. **HANDRAILS:** IRC R311.7.8 & 311.8.3. All stairways with 4 or more risers and ramps exceeding a slope of 1:12 (8.33%) shall have at least one handrail. Such handrails shall be placed not less than 34" and not more than 38" above the nosing of the treads. Handrails for stairways shall be continuous for the full length of the flight from a point directly above the top riser to a point directly above the lowest riser of the flight or the full length of a ramp. The handgrip portion of the handrail shall not be less than 1-1/4" or more than 2-1/4" (maximum 2" if circular) in cross-sectional dimension, and shall be of a graspable shape. (see Page 20 for handrails) There shall be a space of not less than 1-1/2" between the wall and the handrail However, the handrail shall not project more than 4-1/2" into the required stair width. Handrail ends shall be returned or shall terminate in a newel post or safety terminals.
30. **STAIRWAYS:** IRC R311.7 Private dwelling stairways shall not be less than 36" in width and shall have a headroom clearance of not less than 6'-8" measured vertically from the sloped plane adjoining the tread nosings, or landing surfaces. (See Item 39 for spiral stairways.)
31. **STAIR RISE & RUN:** IRC R311.7 Maximum riser height shall be 7-3/4" and the minimum tread depth shall be 10". The greatest riser height may not exceed the smallest by more than 3/8". The radius curvature at the leading edge of the tread shall be no greater than 9/16". A nosing not less than 3/4" but not more than 1-1/4" shall be provided on stairways with solid risers. The greatest nosing



projection shall not exceed the smallest nosing projection by more than 3/8" between two stories, including the nosing at the level of floors and landings. Exception: A nosing is not required where the tread depth is a minimum of 11". Open risers are permitted, provided that the opening between treads does not permit the passage of a 4" diameter sphere.

32. **STAIRWAY ILLUMINATION R311.7.9, R303.6.7, R303.7** All interior and exterior stairways shall be provided with a means to illuminate the stairs, including the landings and treads. **Stairway illumination shall receive primary power from the building wiring.** Interior stairways shall be provided with a light located in the immediate vicinity of each landing of the stairway that provides at least 1 foot candle of illumination measured at the center of treads and landings. A wall switch shall be provided at each floor level where the stairway has six or more risers. Exterior stairways shall be provided with an artificial light source located in the immediate vicinity of the top landing of the stairway. Exterior stairways providing access to a basement from the outside grade level shall be provided with an artificial light source located in the immediate vicinity of the bottom landing of the stairway. The illumination of exterior stairways shall be controlled from inside the dwelling unit.
33. **USABLE SPACE UNDER STAIRS:** IRC R302.7 The walls and soffits of enclosed usable space under stairs shall be protected on the enclosed side by not less than 1 layer of 1/2" gypsum board.
34. **WINDING STAIRWAYS:** IRC R311.7.5.2.1 Winding stairways shall have minimum tread depth of 6" and a minimum tread depth of 10" measured between the vertical planes of the foremost projection of adjacent treads at the intersections with the walk line.

STRUCTURAL

35. **MIN. CONCRETE FOOTING SIZE;** IRC R403.1, R403.1.3.
- Supporting 1 floor: minimum 6" by 12".
 - Supporting 2 floors: minimum 6" x 15".
 - Supporting 3 floors: minimum 8" x 23".

All exterior walls shall be supported on continuous footings or other approved structural systems of sufficient design to accommodate all loads and to transmit the resulting loads to the supporting soil within the limitations determined from the characteristics of the soil. Footings

shall be supported on undisturbed natural soil or engineered fill. As a minimum standard, see Prescriptive Foundation Requirements, on Page 16.

36. **MIN. CONCRETE FOOTING REINFORCEMENT:** Kitsap County Code 14.04.558B & IRC Section 403. At least two #4 bars are required for all continuous concrete footings located 3" above the bottom of the footing. As a minimum standard, *Prescriptive Foundation Requirements* on Page 15.
37. **MIN. CONCRETE FOUNDATION WALL SIZE:** IRC 404.1.4.2, Walls that exceed 8' in height or have more than 4' of unbalanced fill and no permanent lateral support at the top of the wall, must be designed, signed and sealed by a Licensed Washington State Design Professional.
38. **MIN CONCRETE FOUNDATION REINFORCEMENT:** IRC Section R404. As a minimum standard, see *Prescriptive Foundation Requirements* on Page 16.
39. **MINIMUM FOOTING DEPTH:** IRC R403.1.4.2. All exterior footings shall be placed at least 12" below the undisturbed ground. Interior footings supporting bearing or bracing walls and cast monolithically with a slab on grade shall extend to a depth of not less than 12" below the top of slab.
40. **SLAB ON GRADE FLOOR:** IRC R403.1.3.2 IRC R309.1. Foundations must extend at least 6" above finish grade. Monolithic foundations shall have footings at least 12" wide, be at least 12" below grade, extend at least 6" above finish grade, and shall have at least two #4 bars at the bottom of the footing and one #4 bar located within 7" of the top of the slab. See Page 16, *Foundation Requirements*, for additional information. Garage or carport floor surfaces shall be sloped to a drain or toward the main vehicle entry doorway.
41. **FOUNDATION ANCHORAGE:** IRC R403.1.6 & R602.11. Anchor bolts shall be not less than 1/2" diameter, embedded at least 7", and spaced no more than 6' apart. (4' if over 2 stories). There shall be a minimum of 2 bolts per piece (sill plate), with a bolt located within 12" of each end of each piece. 3" x 3" x 0.229" thick hot dipped galvanized plate washers, and nuts shall be tightened on each bolt to the plate. If foundation anchor straps are used instead of anchor bolts, they shall be spaced no more than 4' apart (3' if over 2 stories).
42. **DAMP-PROOF FOUNDATION WALLS:** IRC Section R406 Exterior foundation walls that retain earth and enclose habitable or usable spaces



located below grade shall be damp proofed in accordance with IRC R406.1 or waterproofed in accordance with IRC 406.2, from the top of the footing to the finished grade by approved methods and materials. All joints in membrane waterproofing shall be lapped and sealed with an adhesive compatible with the membrane.

43. **PIER PADS & COLUMNS:** IRC R407.3. Concrete pier footings shall have a depth to width ratio not to exceed 2:1, or, shall have #4 bars located each direction spaced not more than 12" o.c. (Rebar must be in place upon inspection.) Positive connections shall be provided to prevent lateral displacement at both the top and bottom of columns.
44. **FOOTING/PIER SETBACK FROM SLOPE:** IRC R403.1.7 The placement of buildings and structures on or adjacent to slopes steeper than 1 unit vertical in 3 units horizontal (33.3%) slope shall conform to Sections R403.1.7.1 through R403.1.7.4. (See also IRC Figure R403.1.7.1) Footings must be embedded in material sufficient to provide vertical and lateral support for the footing without detrimental settlement.
45. **CHIMNEY FOUNDATION:** IRC R1001.2 and R1003 Masonry chimneys shall be supported on foundations of solid masonry or concrete at least 12" thick, at least 6" beyond each side of the exterior dimensions of the chimney, be at least 12" below grade, and on natural undisturbed earth or engineered fill.. Reinforcement shall conform to the requirements set forth in IRC Table R1001.1.
46. **FOUNDATION VENTILATION:** IRC R408.2. Minimum net area of ventilation openings shall not be less than 1 square foot for each 300 square feet of under-floor space area. One such ventilating opening shall be within 3' of each corner of the building except one side of the building is permitted to have no ventilation openings.. Ventilation openings shall be covered for their height and width with materials identified in IRC R408.2 such that the openings are not larger than ¼ inch.
47. **PROTECTION AGAINST DECAY:** IRC R317.1, R317.3.1. All wood in contact with the ground that supports permanent structures intended for human occupancy shall be approved pressure preservative treated wood suitable for *ground contact* use and treated in accordance with AWPA U1. All wood framing members that rest on concrete or masonry foundation walls shall be treated wood or decay-resistant heartwood of redwood, black locust, or cedars. Cut ends of

pressure-treated wood shall be treated in accordance with AWPA M4. (Note: All fasteners used in pressure treated lumber [sills, joists to sill, rim joist to sill, etc.] shall be hot dipped galvanized, stainless steel, silicon bronze or copper.)

48. **POSTS, POLES AND COLUMNS:** IRC R317.1.2, R317.1.4. Columns and posts supporting permanent structures that are embedded in concrete or in direct contact with the ground or embedded in concrete exposed to the weather shall be approved pressure treated wood suitable for ground contact use. Posts or columns which are exposed to weather, or are located in basements or cellars, shall be supported by piers or metal pedestals projecting 1" above the floor (and 6" above exposed earth) and shall be separated by an approved impervious moisture barrier, or must be of pressure treated wood, or wood of natural resistance to decay. Posts or columns in enclosed crawl spaces located within the periphery of the building, supported by concrete piers or metal pedestals shall be greater than 8" from exposed ground and must be separated by a moisture barrier or be of pressure treated wood.
49. **POST-BEAM CONNECTIONS/FASTENING:** IRC R301, R407.3, R502.9. Where posts and beam or girder construction is used to support framing, positive connections shall be provided to ensure against uplift and lateral displacement. The construction of buildings and structures shall result in a system that provides a complete load path capable of transferring all loads from their point of origin through the load resisting elements to the foundation.
50. **FLOOR FRAMING:** IRC R502.3, R502.6, R502.6.1, R502.7 The ends of each joist, beam or girder shall have not less than 1-1/2" of bearing on wood or metal or not less than 3" on masonry or concrete. Joists framing from opposite sides over a bearing support shall lap a minimum of 3" and shall be nailed together with a minimum three 10d face nails. Joists shall be supported laterally at each end and at each intermediate support by full-depth solid blocking not less than 2" nominal thickness; or by attachment to a header, band, or rim joist; or shall be otherwise provided with lateral support to prevent rotation. See IRC Tables R502.3.1 (1) & (2) for floor joist spans, R502.5 (1) & (2) for girder spans, and R502.3.3 (1) & (2) for cantilever spans. A load path for lateral forces



shall be provided between floor framing and braced wall panels located above or below a floor.

51. **BEARING PARTITIONS:** IRC 502.4. Joists under parallel bearing partitions shall be of adequate size (as a beam) to support the load. Double joists, sized to adequately support the load, that are separated to permit the installation of piping or vents shall be full-depth, solid-blocked with lumber not less than 2" in nominal thickness spaced not more than 4' o.c. Bearing partitions perpendicular to joists shall not be offset from supporting girders, walls or partitions more than the joist depth unless such joists are of sufficient size to carry the additional load(s).
52. **UNDER-FLOOR CLEARANCE:** IRC 317.1. When floor joists or the bottom of a wood structural floor are located within 18" or wood girders are located within 12" to the exposed ground in crawl spaces or unexcavated area located within the periphery of the building foundation, all components of the floor assembly shall be pressure treated wood or wood of natural resistance to decay, including all posts, beams or girders, joists and sub-floor. The under-floor grade shall be cleaned of all vegetation and organic material. All wood forms used for placing concrete and construction materials shall be removed before the building is occupied
53. **UNDER-FLOOR ACCESS:** IRC 408.4. Access shall be provided to all under-floor spaces. Access openings through the floor shall be a minimum of 18" x 24". Openings through a perimeter wall shall be at least 16" x 24". When any portion of the through wall access is below grade, an areaway of not less than 16" x 24" shall be provided. The bottom of the areaway shall be below the threshold of the access opening. Through wall access openings shall not be located under a door to the residence. Underfloor spaces containing appliances shall be provided with an unobstructed passageway large enough to remove the largest appliance but not less than 30" high by 22" wide, nor more than 20' long from the opening to the appliance. A level service space of at least 30" by 30" shall be provided at the front or service side of the appliance. See M1305.1.4 for details of mechanical equipment access.
54. **WALL FRAMING:** IRC 602.3.1, 602.3.2, 602.3.3, 602.3.4, 602.6 & 602.9. Studs shall be a minimum No. 3, standard or stud grade lumber, except that utility studs may be used for bearing studs not supporting a floor above or nonbearing studs. Utility grade studs shall not be spaced more than

16" on center, support more than a roof and ceiling, or exceed 8' in height for exterior and load bearing walls. The size, height, and spacing of all other wood-framing studs shall be in accordance with Table R602.3.(5). (Maximum 10 feet in Seismic Design Category D₂.) Studs shall be placed with their wide dimension perpendicular to the wall. Wood stud walls shall be capped with a double top plate installed to provide overlapping at corners and intersections with bearing partitions. End joints shall be offset at least 24". Studs shall have full bearing on a nominal 2" or larger plate or sill having a width at least equal to the width of the studs. Where joists, trusses, or rafters are spaced more than 16" o.c. and the bearing studs are spaced 24" o.c. such members shall bear within 5" of the studs beneath.

- **Cutting and notching:** May not exceed 25% of the stud width in bearing or exterior walls and may not exceed 40% of a single stud width in non-bearing partitions.
 - **Bored or drilled holes:** The diameter of the resulting hole may not exceed 40% of the stud width, can be no closer than 5/8" to the edge of the stud, and may not be located in the same section as a cut or notch. See IRC Section R602.6 for exceptions See IRC Figures R602.6 (1), R602.6.2 (2), and R602.6.1 for additional details.
 - **Foundation Cripple walls, IRC R602.9:** Foundation cripple walls shall be framed of studs not less in size than the studding above. When exceeding 4'-0" in height, such walls shall be framed of studs having the size required for an additional story. Cripple walls with a stud height less than 14" shall be sheathed on at least one side with a wood structural panel that is fastened to both the top and bottom plates in accordance with Table R602.3(1) or the cripple walls shall be constructed of solid blocking. Cripple walls in Seismic Design Category D₂ shall be supported on continuous foundations.
55. **WALL BRACING:** IRC 602.10. All braced walls and cripple wall bracing in Seismic Design Category D₂ shall be constructed in accordance with IRC Table R602.10.1.3(1) & (3) and Sections R602.10 and R602.11. Typically braced wall panels require nailing patterns of 6" o.c. along all panel edges. All sheathing joints must be over studs (vertically) or solid blocking (horizontally).



- **Braced wall panels shall begin no more than 10' 0" from each end of a braced wall line. If the braced wall panel is not located at the corner, then a 24" panel is required at the corner return panel (in addition to the 4' BWP within 10') Or, a hold down device is required at the end of the braced wall panel end nearest the corner.**
 - **Spacing of interior braced wall lines shall not exceed 25' apart , an increase to 35' is allowed adjustment factors will apply, See IRC R602.10.3(4).**
 - **Braced wall lines may have offsets, out of plane of up to 4'0".**
 - **In one-story buildings, braced wall panels shall be supported on continuous foundations at intervals not exceeding 50'. In two- story buildings all interior braced wall panels shall be supported on continuous foundations. (See exceptions in IRC R602.10.9.1)**
 - **Interior braced wall panels shall be fastened to both the floor and roof framing in accordance with Table R602.10.8(1) & (2)**
 - **Cripple walls supporting bearing walls or exterior walls or interior braced wall panels as required in IRC R403.1.2 shall be braced in accordance with Tables R602.10.3(3) & (4). Cripple wall greater than 4' shall be designated as the first story wall for purposes of designating the wall bracing requirements (R602.10.7.1).**
 - **Where "stepped foundations" occur, See IRC R602.10.11.2 for additional requirements such as plate strapping, cripple wall height limitations, etc.**
 - **See the attached "Braced Wall Panel" and "Alternate Braced Wall Panel" details for typical construction requirements.**
56. **OPENINGS IN EXTERIOR & INTERIOR WALLS (HEADERS):** IRC R602.7. Headers shall be provided over each opening in interior and exterior bearing walls. Headers shall be sized to support the load above in accordance with IRC Tables R502.5(1), R502.5(2), and R602.7.1 . Alternately, wood structural box headers may be used in accordance with IRC **R602.7.2 & Table R602.7.2 and Figure R602.7.1(2)**. Each end of all headers shall have at least 1.5" of full-width bearing.
57. **FIRE-BLOCKS & DRAFT-STOPS:** IRC **R602.9, R502.10**. Fire blocking & Draft stopping shall be installed to cut off all concealed vertical and

horizontal draft openings and shall form an effective fire barrier between stories and between a top story and the roof space. Fire blocking shall be provided in concealed spaces of wood stud walls and partitions: vertically at the ceiling and floor levels; horizontally at intervals not exceeding 10'; and at all interconnections between concealed vertical and horizontal spaces such as occur at soffits, drop ceilings and cove ceilings, as well as stair stringers at the top and bottom of the run and openings around vents, pipes and ducts at ceiling and floor levels. Fire blocking materials shall consist of materials listed in IRC **R602.11.1**. Loose-fill insulation material shall not be used as a fire block unless specifically tested in the form and manner intended. Fire blocking of chimneys and fireplaces shall be in accordance with IRC **R1003.19**. When there is usable space both above and below a concealed space of a floor/ceiling assembly, draft stops shall be installed so that the area of the concealed space does not exceed 1000 square feet. Draft stopping materials shall consist of materials listed in Section **R302.12.1**. All fire blocking and draft stopping shall be in place prior to requesting a framing inspection.

58. **SIDING TYPE** IRC Section **R703 & R701.2** Exterior wall coverings shall be installed, attached and flashed in accordance with the provisions of IRC Section R703 and the siding manufacturer's installation instructions. **Please note that masonry wall coverings exceeding 3" in thickness require an engineered design in Seismic Design Category D₂** (all of Kitsap County). See #68
59. **WEATHER RESISTIVE BARRIER:** IRC R701.2, R703.2, R703.4 R703.8, R703.9.1 Products sensitive to adverse weather shall not be installed until adequate weather protection for the installation is provided. Exterior sheathing shall be dry before applying exterior cover. The exterior wall envelope shall be designed and constructed to provide a water-resistant barrier behind the exterior veneer. Asphalt-saturated felt or other approved weather resistant material such as house wrap shall be applied over the sheathing of all exterior walls except where panel siding with shiplap joints or other approved weather resistive methods are used. Such felt or house wrap material shall be applied horizontally, with the upper layer lapped over the lower layer not less than 2".



60. **FLASHING:** IRC R703.8 Approved corrosion-resistant flashing shall be provided in all exterior walls in such a manner as to prevent entry of water into the wall or the building structural framing components. The flashing shall extend to the surface of the exterior wall finish and shall be installed to prevent water from reentering the exterior wall envelope. Approved corrosion-resistant flashings shall be installed the following locations:
1. **Exterior window and door openings.**
Flashing at exterior window and door openings shall extend to the surface of the exterior wall finish or to the water-resistant barrier for subsequent drainage.
 2. **At the intersection of chimneys or other masonry construction with frame or stucco walls, with projecting lips on both sides under stucco copings.**
 3. **Under and at the ends of masonry, wood or metal copings and sills.**
 4. **Continuously above all projecting wood trim.**
 5. **Where exterior porches, decks or stairs attach to a wall or floor assembly of wood-frame construction.**
 6. **At wall and roof intersections.**
 7. **At built-in gutters.**
61. **SIDING/EARTH SEPARATION:** IRC Section R317. Wood siding, sheathing and wall framing on the exterior of the building used within 6" of earth shall be pressure treated wood or wood of natural resistance to decay as identified in item #52 of this checklist.
62. **DECKS & EXTERIOR STAIRS:** IRC Section R507. Pressure treated wood shall be used for those portions of exposed wood members and members subject to wind driven rain, such as within a covered porch, that form the structural supports of buildings, balconies, porches or similar appurtenances, including all joists, beams, girders, decking and posts, poles and columns. Treatment must be applied by manufacturer, see item #52 of this check-list. Ledger boards fastened to a wall shall be properly flashed and positively connected. Where supported by attachment to an exterior wall, decks shall be positively anchored to the primary structure and designed for both vertical and lateral loads as applicable. Such attachment shall not be accomplished by the use of toenails or nails subject to withdrawal.
63. **WOOD TRUSSES:** IRC R502.11, R802.10. Wood trusses shall be designed in accordance with approved engineering practice. Engineering data and installation specifications, including the type of roofing to be used, shall be available on site at framing inspection. Trusses shall be supported laterally at points of bearing by solid blocking to prevent rotation and lateral displacement, and braced in accordance with the individual truss design drawings. Truss members shall not be cut, notched, drilled, spliced or otherwise altered in any way without the specific approval of a registered design professional (structural calculations required). Alterations resulting in the addition of load (e.g., HVAC equipment, water heaters, etc.) that exceed the design load shall not be permitted without specific engineering justifying the design.
64. **RAFTERS:** IRC Section R802 Rafters shall be framed to ridge board or to each other with a gusset plate as a tie. The ridge board shall be at least 1" nominal thickness, and all valley or hip rafters shall be at least 2" nominal thickness. Rafter ties shall be placed not more than 4' o.c. **See IRC Tables 802.4(1) through 802.5.1(9) for allowable spans.** When the depth-to-thickness ratio exceeds 5 to 1 the roof rafters and ceiling joists shall be provided lateral support at points of bearing to prevent rotation.
65. **RAFTER OPENINGS:** IRC R802.9. When the header joist span does not exceed 4', the header joist may be a single member the same size as the ceiling joist or rafter. Single trimmer joists may be used to carry a single header joist that is located within 3' of the trimmer joist bearing. Trimmer and header rafters shall be doubled and of sufficient size to support all loads when the span of the header exceeds 4'. Approved hangers shall be used when the span exceeds 6'. Tail joists over 12' long shall be supported at the header by framing anchors or on ledger strips not less than 2" x 2".
66. **CEILING JOISTS:** IRC R802.4, R802.8, and R802.8.1 Ceiling joist spans shall be in accordance with IRC Tables R802.4 (1) and R802.4 (2) or specifically designed for applied loads. Rafters and ceiling joists having a depth-to-thickness ratio exceeding 5 to 1 shall be provided with lateral support at points of bearing to prevent rotation. Rafters and ceiling joists having a depth-to-thickness ratio exceeding 6 to 1 shall be supported laterally by solid blocking, diagonal bridging (wood or metal) or continuous 1" x 3"



wood strip nailed across the rafter ceiling joists at intervals not exceeding 8'.

67. **ROOF SHEATHING:** IRC Section R803. Allowable spans for lumber used as roof sheathing shall conform to Table R803.1 Spaced lumber sheathing ("skip sheathing") is prohibited in Seismic Design Category D₂. Wood structural panels shall be identified by grade mark or certificate of inspection issued by an approved agency and shall comply with the grades and spans specified in Table R503.2.1.1 (1).
68. **ROOF DRAINAGE & COVERING** IRC R801.3, R903, R904, R905. All structures shall have a controlled method of water collection and disposal from roofs (typically gutters). Water shall discharge to an approved drainage system or to splash blocks where a drainage system is not required. Roofs that do not drain over edges shall have roof drains installed at the low point of the roof as well as overflow drains. See IRC R903.4. Roof slope shall be indicated on the plans and selected roof covering must be appropriate for the roof pitch. Roof coverings must be installed in accordance with the manufacturer's installation instructions. Flashing shall be installed at wall & roof intersections, at changes in roof slope or direction, and around roof openings. Where flashing is metal, the metal shall be corrosion-resistant with a minimum thickness of 0.019 inch (No. 26 galvanized sheet). Roof dead loads are limited to a maximum of 15 pounds per square foot unless the additional bracing provisions of R301.2.2.2.1 are provided.
69. **ATTIC VENTILATION:** IRC Section R806. Enclosed attics and rafter spaces shall have cross ventilation. For each separate space, the total net free ventilating area shall not be less than 1 to 150 of the area of the space ventilated, the total area is permitted to be reduced to 1 to 300, provided **at least 40 percent and not more than 50 percent of the required ventilating area is provided by ventilators located in the upper portion of the attic or rafter space. Upper ventilators shall be located no more than 3' below the ridge or highest point of the space, measured vertically, with the balance of the required ventilation provided by eave or cornice vents. Where the location of wall or roof framing members conflicts with the installation of upper ventilators, installation more than 3' below the ridge or highest point of the space shall be permitted.**

70. **CHIMNEY HEIGHT:** IRC R1003.9, R1003.20. Chimneys shall extend at least 2' higher than any portion of a building within 10', but shall not be less than 3' above the highest point where the chimney passes through the roof. Chimneys shall be provided with crickets when the dimension parallel to the ridgeline is greater than 30" and does not intersect the ridgeline. The cricket and chimney shall be built & flashed according to Figure R1003.20 and Table R1003.20.

GENERAL

71. **PREMISES IDENTIFICATION: Kitsap County Code 16.66** IRC R319.1. Addresses shall be provided in such a position as to be plainly visible and legible from the street or road fronting the property. Numerals shall be at least 4" high with 1/2" stroke and be conspicuously displayed on a contrasting background. If the building is not clearly visible from a named way of travel, the numerical designation (address) shall also be displayed near the main entrance to the property as well as at the driveway entrance that leads to the building. Property addresses shall be posted prior to requesting any inspections.
72. **APPROVED PLANS:** IRC R105.7, R106.3.1, R106.4. When the building official issues a permit, the construction documents shall be approved in writing or by stamp. Work shall be done in accordance with the approved construction documents, any changes made during construction shall be resubmitted for approval. The building permit, inspection card, and 1 set of approved construction documents must remain on the job site at all times until the completion of the project.
73. **HEATING: IRC R303.9.** Every dwelling unit shall be provided with heating facilities capable of maintaining a room temperature of 68° F at a point 3' above the floor and 2' from exterior walls in all habitable rooms. Primary heating sources in all new and substantially remodeled buildings in designated areas shall not be dependent upon wood stoves. No used solid fuel burning device shall be installed in new or existing buildings unless such device is United States Environmental Protection Agency certified or a pellet stove either certified or exempt from certification by the United States Environmental Protection Agency.
74. **INTERIOR FINISH:** IRC R302.9, R702.3.8 & R702.4.2, R702.3.8.1. Wall and ceiling finishes shall have a flame-spread classification of not greater than 200 and a smoke-developed index of



not greater than 450, except for trims, handrails, door and window frames, and wallpaper. When gypsum is used as a base for tile or wall panels for tub/shower enclosures, water-resistant gypsum conforming to ASTM C 1396, C1178, or C1278 shall be used. Water resistant gypsum wallboard may not be used over a Class I or II vapor retarder in a shower or tub compartment, or on ceilings where frame spacing exceeds 12" o.c. for 1/2" or 5/8" gypsum board, or where there will be direct exposure to water, or in areas subject to continuous high humidity. Fiber-cement, fiber-mat reinforced cement, glass mat gypsum backers, or fiber-reinforced gypsum backers in compliance with ASTM C 1288, C 1325, C 1178, or C 1278 and installed in accordance with manufacturers recommendations shall be used as backers for wall tile in tub & shower areas and wall panels in shower areas. Wood veneer paneling and hardboard paneling shall be placed on wood or cold-formed steel framing spaced not more than 16" o.c. Wood veneer and hardboard paneling less than 1/4" nominal thickness shall have gypsum board backer at least 3/8" thick. Wood veneer

paneling of at least 1/4" nominal thickness shall conform to ANSI/HPVA HP-1, and hardboard paneling shall conform to CPA/ANSI A135.5.

75. **GYPSON WALLBOARD FASTENING:** IRC R702.3.6 & Table R702.3.5. Screws for attaching gypsum board to wood framing shall be type W or Type S in accordance with ASTM C 1002 and shall penetrate the wood not less than 5/8", and structural insulated panels at least 7/16".
- 3/8" minimum from edge and ends for nails or screws.
 - Fastening (nails): 7" o.c. max. ceiling; 8" o.c. max. walls.
 - Fastening (screws): 12" o.c. ceiling; 16" o.c. walls when wall framing is 16" o.c., 12" o.c. when wall framing is 24" o.c.

Footnote e, Table R702.3.5: Type X gypsum wallboard for garage ceilings beneath habitable rooms shall be installed perpendicular to the ceiling framing and shall be fastened at 6" o.c. by minimum 1-7/8" 6d coated nails or equivalent drywall screws.

ENERGY CODE: BASED UPON WASHINGTON STATE ENERGY CODE AND IRC CHAPTER 15 AMENDMENTS

76. **VAULTED CEILING INSULATION:** WSEC 402.2.1, 402.2.1.1, 402.2.3 and Table R402.1.1. Open-blown or poured loose fill insulation may be used in attic spaces where the slope of the ceiling is not more than 3' in 12' and there is at least 30" of clear distance from the top of the bottom chord of the truss or ceiling joist to the underside of the sheathing at the roof ridge. Baffles shall be rigid material, resistant to wind driven moisture. Enclosed attics and enclosed rafter spaces formed where ceilings are applied directly to the underside of roof framing members shall have cross ventilation for each separate space by ventilating openings protected against the entrance of rain and snow. Blocking and bridging shall be arranged so as not to interfere with the movement of air. A minimum of 1" of airspace shall be provided between the insulation and the roof sheathing. **The baffles shall be installed adjacent to soffit and eave vents and over the top of the attic insulation. The baffle shall be permitted to be any solid material.** Roof/ceiling assemblies where the ventilation space above the insulation is less than an average of 12" shall be provided with a vapor retarder. Faced batt

insulation where used as a vapor retarder shall be face stapled. Single rafter joist vaulted ceiling cavities shall be of sufficient depth to allow a minimum 1" vented air space above the insulation. See WSEC 502.1.6.3 for exception for unvented attic assemblies. Single rafter or joist vaulted ceilings shall be insulated to at least R-38.

77. **HATCHES AND DOORS:** WSEC 402.2.4. Access doors from conditioned to unconditioned spaces (such as attic and crawl space access doors) shall be weather-stripped and insulated to a level equivalent to the insulation on the surrounding surfaces. A wood framed or equivalent baffle or retainer must be provided when loose fill insulation is installed, the purpose of which is to prevent the loose fill insulation from spilling into the living space when the attic access is opened, and to provide a permanent means of maintaining the installed R-value of the loose fill insulation.
78. **DUCT INSULATION:** WSEC R403.2.2 through R403.2.3. All heating ducts within unconditioned spaces shall be insulated to a minimum of R-8. **The exception is ducts or portions located completely inside the building thermal**



- envelope. Ducts located in crawl spaces do not qualify.
79. **PIPE INSULATION:** WSEC R403.3. Water pipes outside of the conditioned space shall be insulated to a minimum of R-4. Cooling and heating systems shall be insulated to R-6.
 80. **VAPOR RETARDER:** IRC R702.7 & R702.7.2. Vapor retarders shall be installed on the warm side (in winter) of insulation. Vapor retarders are not required in roof/ceiling assemblies where the ventilation space above the insulation averages 12" or greater or where all of the insulation is installed between the roof membrane and the structural roof deck.. Faced batt insulation where used as a vapor retarder shall be faced stapled.
 81. **VAPOR BARRIER IN CRAWL-SPACE:** WSEC 502.1.6.7. A ground cover of 6 mil black polyethylene shall be laid over the ground within crawl spaces. The ground cover shall be overlapped 12" minimum at the joints and shall extend to the foundation wall.
 82. **VENTILATION DUCTS:** IRC M1507.3.3, M1508.5.3, M1508.7.3. All ventilation exhaust ducts shall be sized in accordance with **Table M1507.3.6.2** and shall terminate outside the building. Exhaust ducts shall be equipped with back draft dampers and shall be insulated to a minimum of R-4 where passing through an unconditioned space.
 83. **WINDOW OR WALL PORTS:** IRC M1507.3.4.4 Outdoor air shall be distributed to each habitable room by individual outdoor air inlets. Individual room outdoor air inlets shall have a controllable and secure opening and be capable of a total opening area of not less than 4 square inches. Outdoor air inlets shall be located so as not to take air from within 10 feet of a plumbing vent opening, or an appliance vent outlet, or where it will pick up objectionable odors, fumes or flammable vapors.
 84. **DISTRIBUTION:** IRC M1507.3.4.4 Where outdoor air supplies (*window or wall ports*) are separated from fan locations by doors, adequate air flow shall be ensured by undercutting doors or installing grilles or transoms. Doors shall be undercut to a minimum of ½" above the surface of the finished floor covering.
 85. **MAKE-UP THROUGH FURNACE:** IRC M1507. Integrated forced-air ventilation systems shall distribute outdoor air to each habitable room through the forced-air system ducts. Integrated forced-air ventilation systems shall have an outdoor air inlet duct connecting a terminal element on the outside of the building to the return air plenum of the forced-air system, at a point within 4' upstream of the air handler. The outdoor air inlet duct connection to the return air stream shall be located upstream of the forced-air system blower and shall not be connected directly into a furnace cabinet to prevent thermal shock to the heat exchanger. The system will be equipped with a motorized damper connected to the automatic ventilation controls specified in M1507.3.2 The required flow rate shall be verified by field testing with a flow hood or a flow measuring station. At the time of final inspection, the automatic control timer shall be set to operate the whole house fan according to the schedule used to calculate the whole-house fan sizing.



PRESCRIPTIVE FOUNDATION DETAILS

For Typical Light Frame Constructed Buildings

Assumptions for this Detail:

- + Conventional Light-Frame construction
- + Wood or other light siding
- + 1500 psf soil bearing cap.
- + Group I, II, or III soils (IRC R405.1)
- + Backfill no closer than 6" to top of wall

Walls must be laterally restrained at the top and bottom of wall


#4 Horizontal bars spaced 18" on center. Top bar must be within 7" of the top of the wall to engage the anchor bolts.

Vertical bars spaced per the schedule below, or in accordance with IRC Tables R401.1.1(5), as adopted by Kitsap County. Bars must be hooked at the connection within the footing.

Reinforcement placed in concrete forms where the concrete will be exposed to earth, shall be at least 1-1/2" from the edge. Where concrete is placed against the earth, there must be at least 3" clearance.

Minimum 1/2" diameter anchor bolts, spaced 6'-0" on center and embedded at least 7 inches, (4'-0" on center if 2 stories) with 3"x3"x1/4" galvanized plate washers and within 12" of each end of each sill board.

Bars must be tied in place
NO WET SETTING

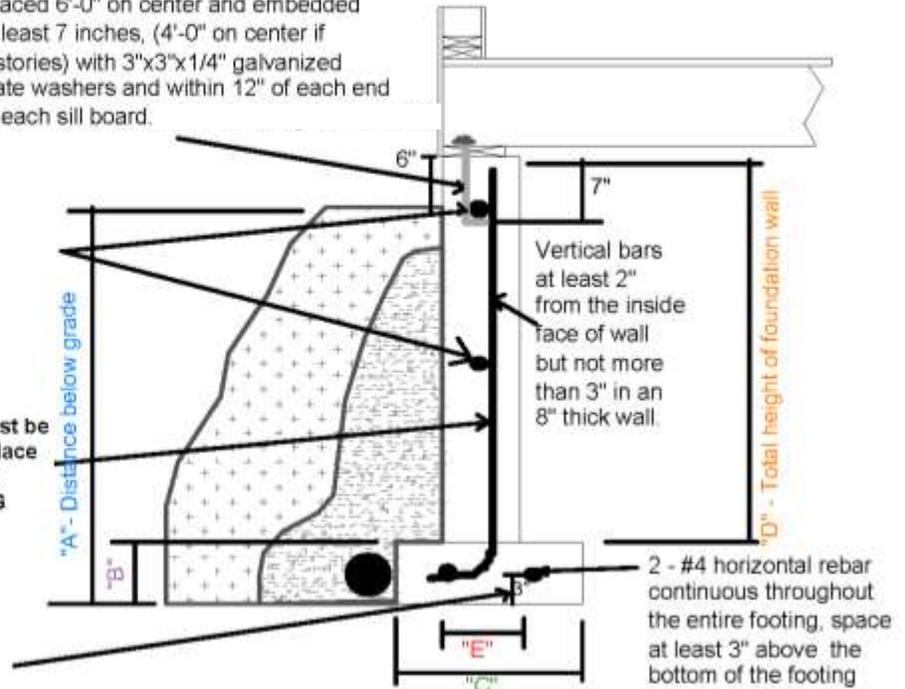

Minimum Requirements for Foundations Supporting Bearing Walls

Number of Floors Supported by Foundation	"E" Minimum Stem Wall Thickness	"A" Depth to Bottom of Footing	"B" Minimum Footing Thickness	"C" Minimum Footing Width	Minimum Footing Reinforcement
1	6"	12"	6"	12"	2 - #4 Bars Cont.
2	6"	12"	6"	15"	2 - #4 Bars Cont.
3	8"	12"	8"	23"	2 - #4 Bars Cont.

Minimum Wall Reinforcement (Grade 60 reinforcement steel)


Minimum Wall Thickness - (E)	Maximum Wall Height - (D)	Horizontal Reinforcement Steel	Vertical Reinforcement Steel*
6"	24"	1 - #4 Bar	#4 bars @ 48" oc
6"	36"	2 - #4 Bars @ 18" on center	#4 bars @ 48" oc
6"	60"	4 - #4 Bars @ 18" on center	#4 bars @ 24" oc
8"	48"	3 - #4 Bars @ 18" on center	#4 bars @ 48" oc
8"	72"	4 - #4 Bars @ 18" on center	#4 bars @ 48" oc
8"	108"	6 - #4 bars @ 18" on center	#7 bars @ 36" oc
10"	108"	6 - #4 bars @ 18" on center	#6 bars @ 36" oc

* Additional options are available for your specific project. See IRC Section R404, as amended in KCC 14.04.558

See Table R404.1.1. (5) as amended by KC CH 14 for additional vertical steel placement.



**FIGURE 4:
TYPICAL PRESCRIPTIVE BRACED WALL PANEL**
(per IRC Section R602.10.3, Method #3)

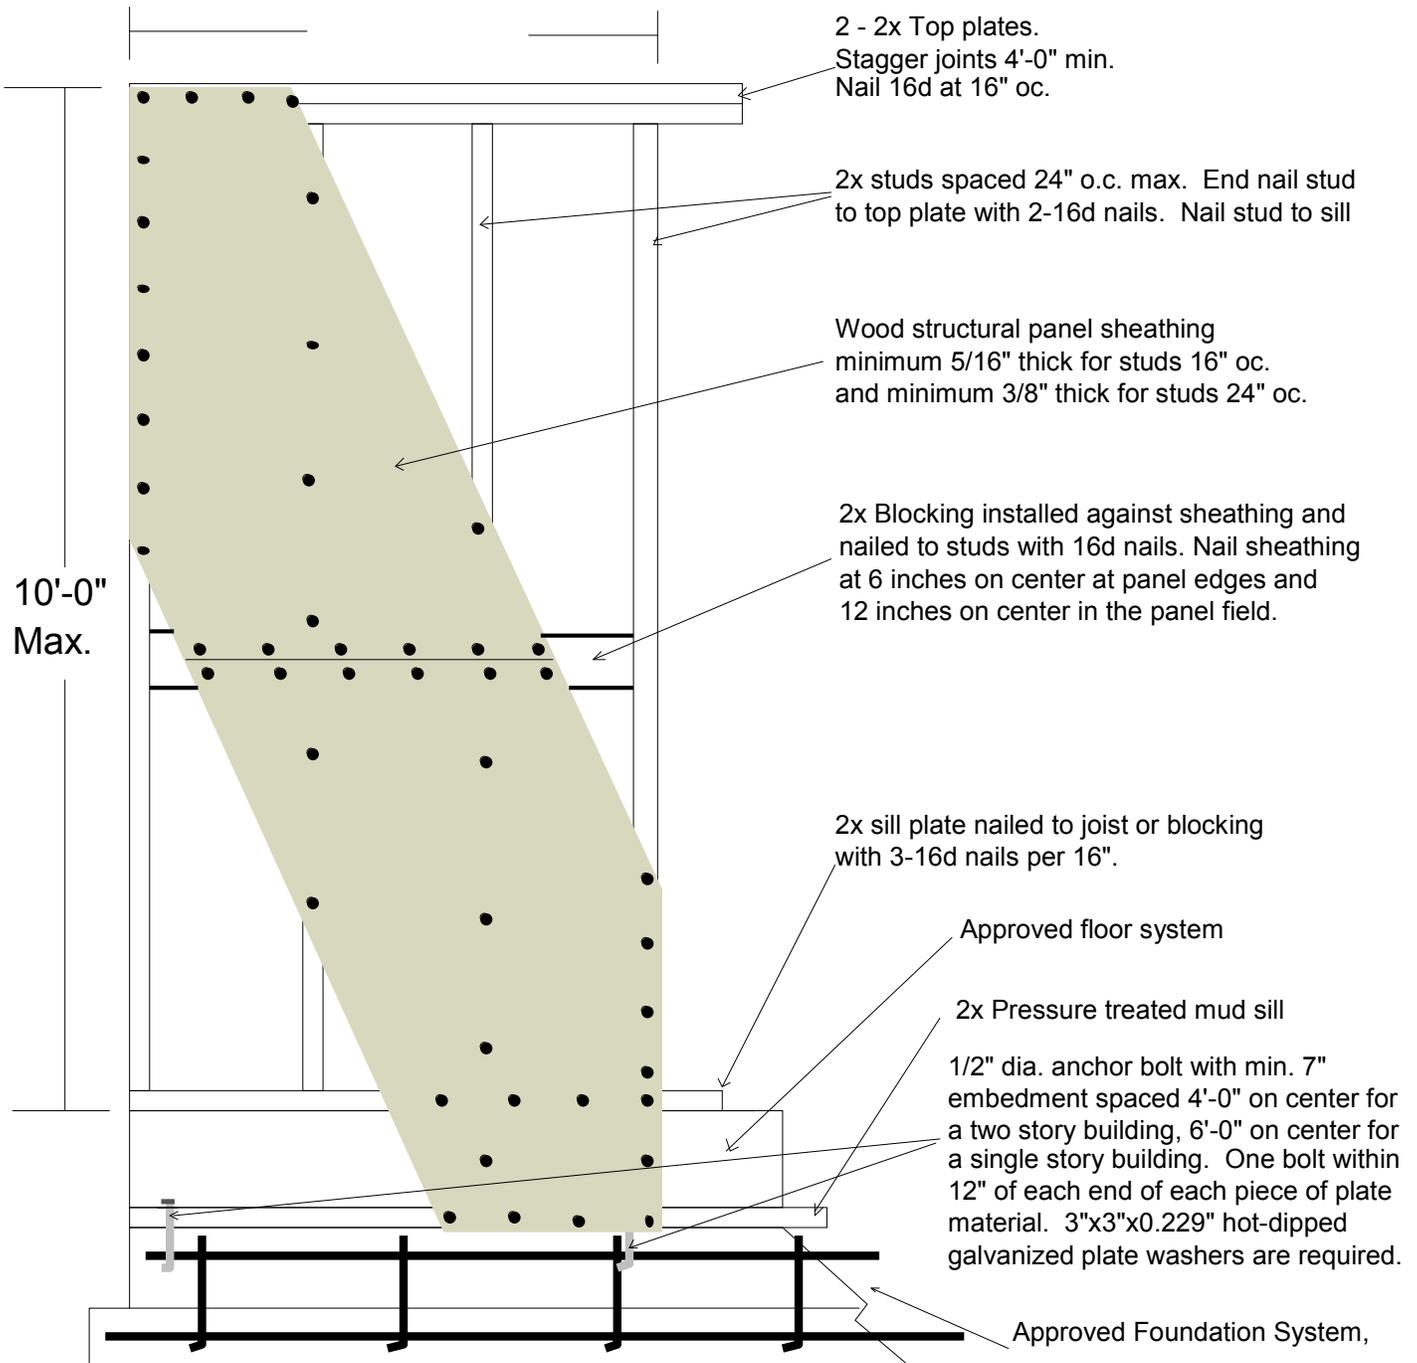


* Nail sheathing with 8d common or galvanized box nails spaced 6" on center at sheathing panel edges and 12" oc. in the field.

Braced wall panels (BWP or ABP) must be located at each end of each braced wall line.
Or, IRC Section R602.10.11 allows the braced wall panel (BWP) to be located up to 8' from the end of the braced wall line, provided there is a hold down device at the end of the BWP nearest the end of the braced wall line. Additional options may also be available, See IRC 602.10 for more information.




**FIGURE 6:
PRESCRIPTIVE ALTERNATE BRACED WALL PANEL**
(per IRC Section R602.10.6)

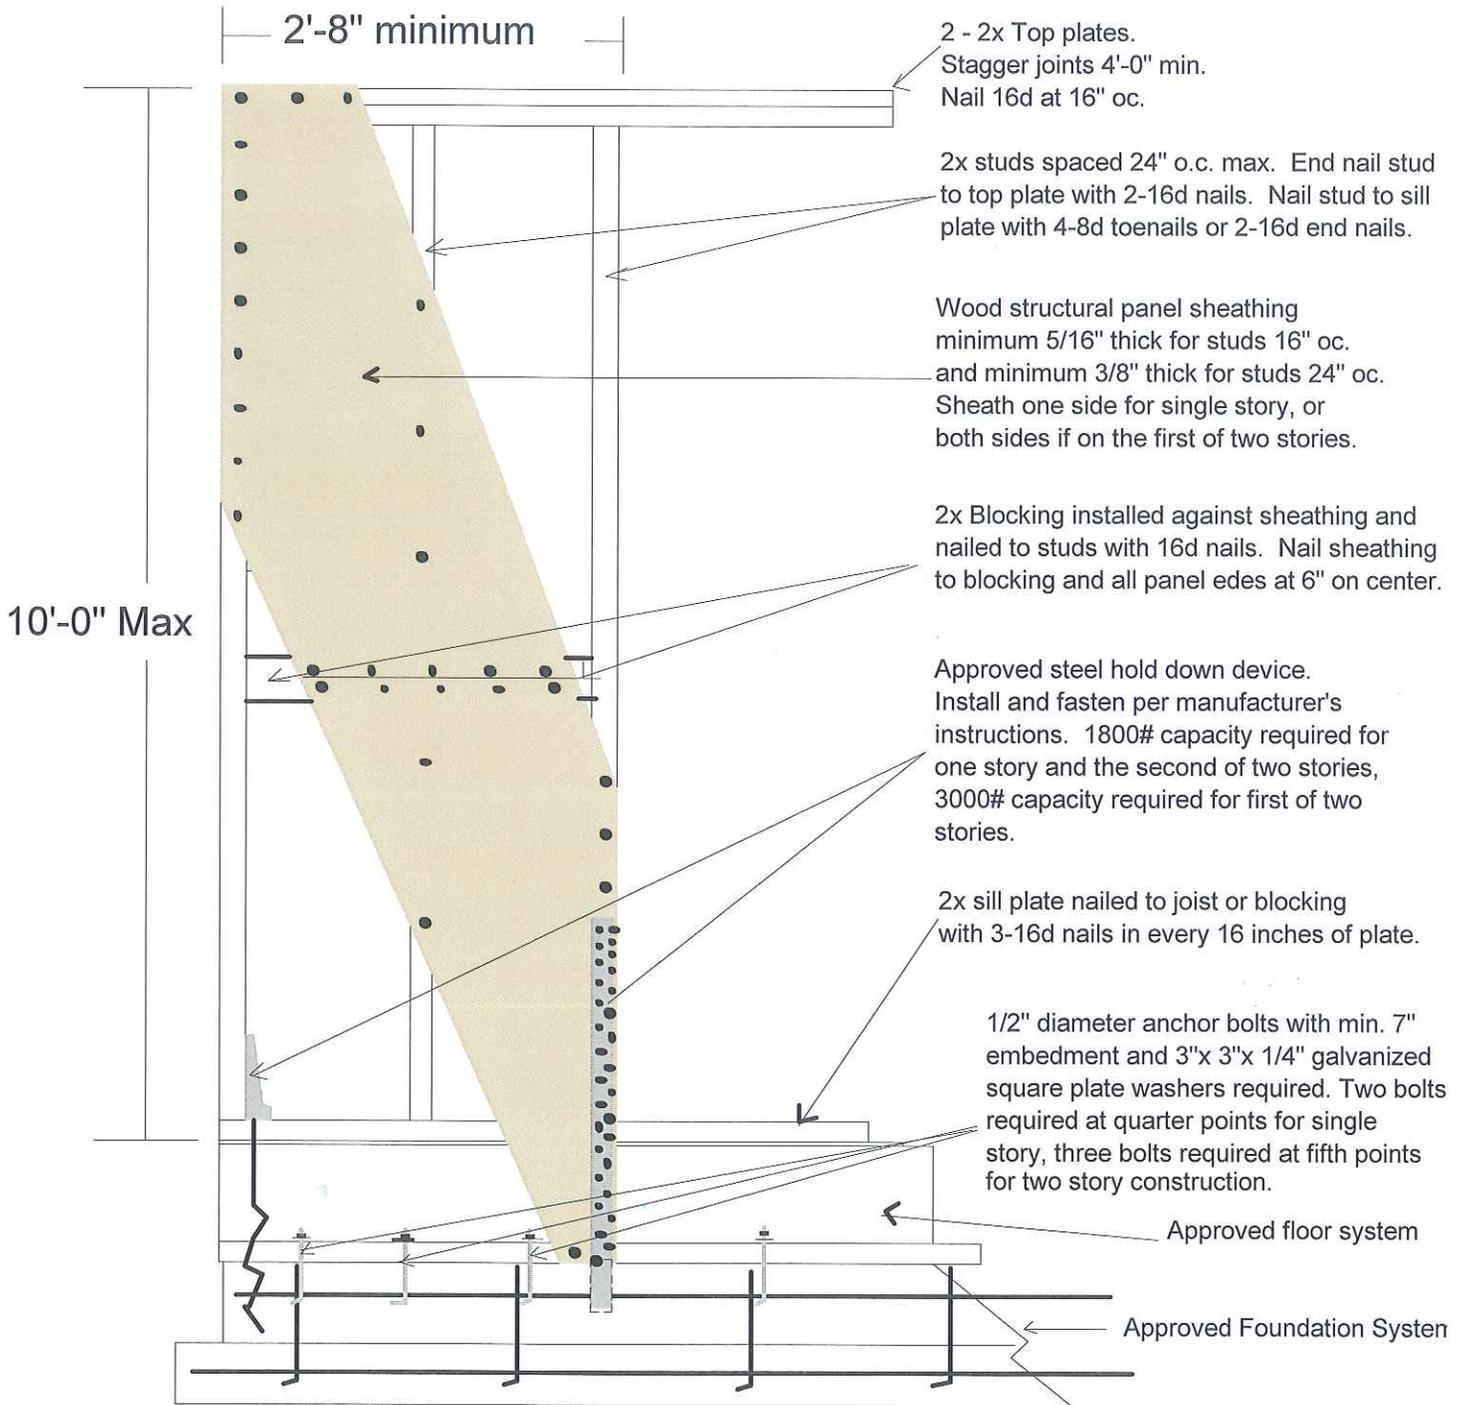

* Nail sheathing with 8d common or galvanized box nails spaced 6" on center at sheathing panel edges and 12" oc. in the field.

**FIGURE 7:
PRESCRIPTIVE GARAGE PORTAL FRAME WITH HOLD-DOWNS
METHOD PFH (IRC Fig. R602.10.6.2)**

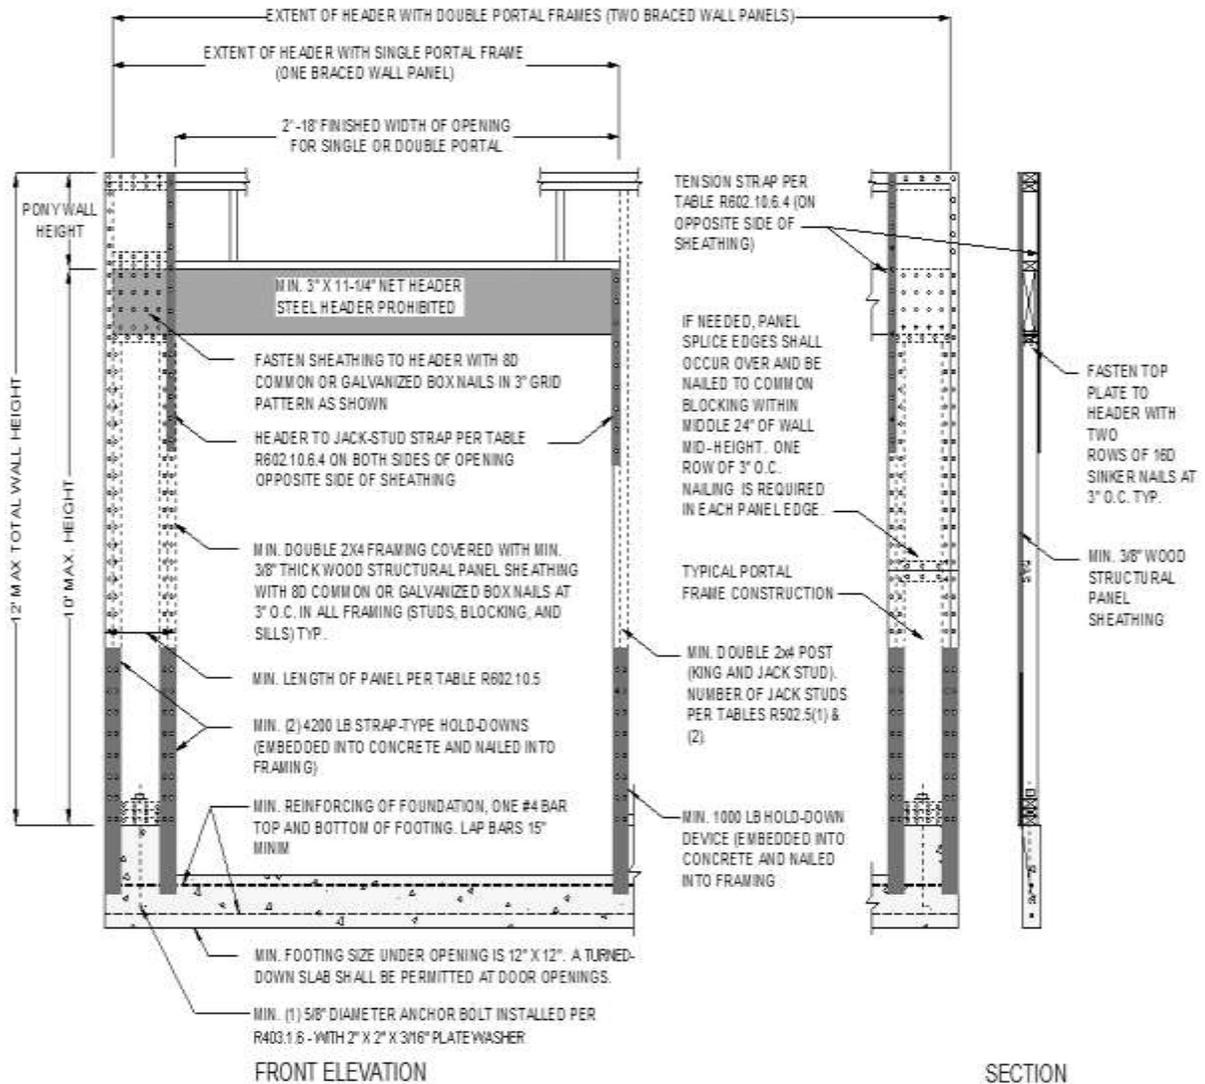

The minimum width of the panel for supporting a roof only is:
16" wide for a 10' high wall and 20" wide for a 12' high wall.


The minimum width of the panel for supporting one story and roof is:
24" wide for a 10' high wall and 29" wide for a 12' high wall.



STANDARD CONSTRUCTION DETAILS


HANDRAILS AND GUARDRAILS

IRC 311.7.7

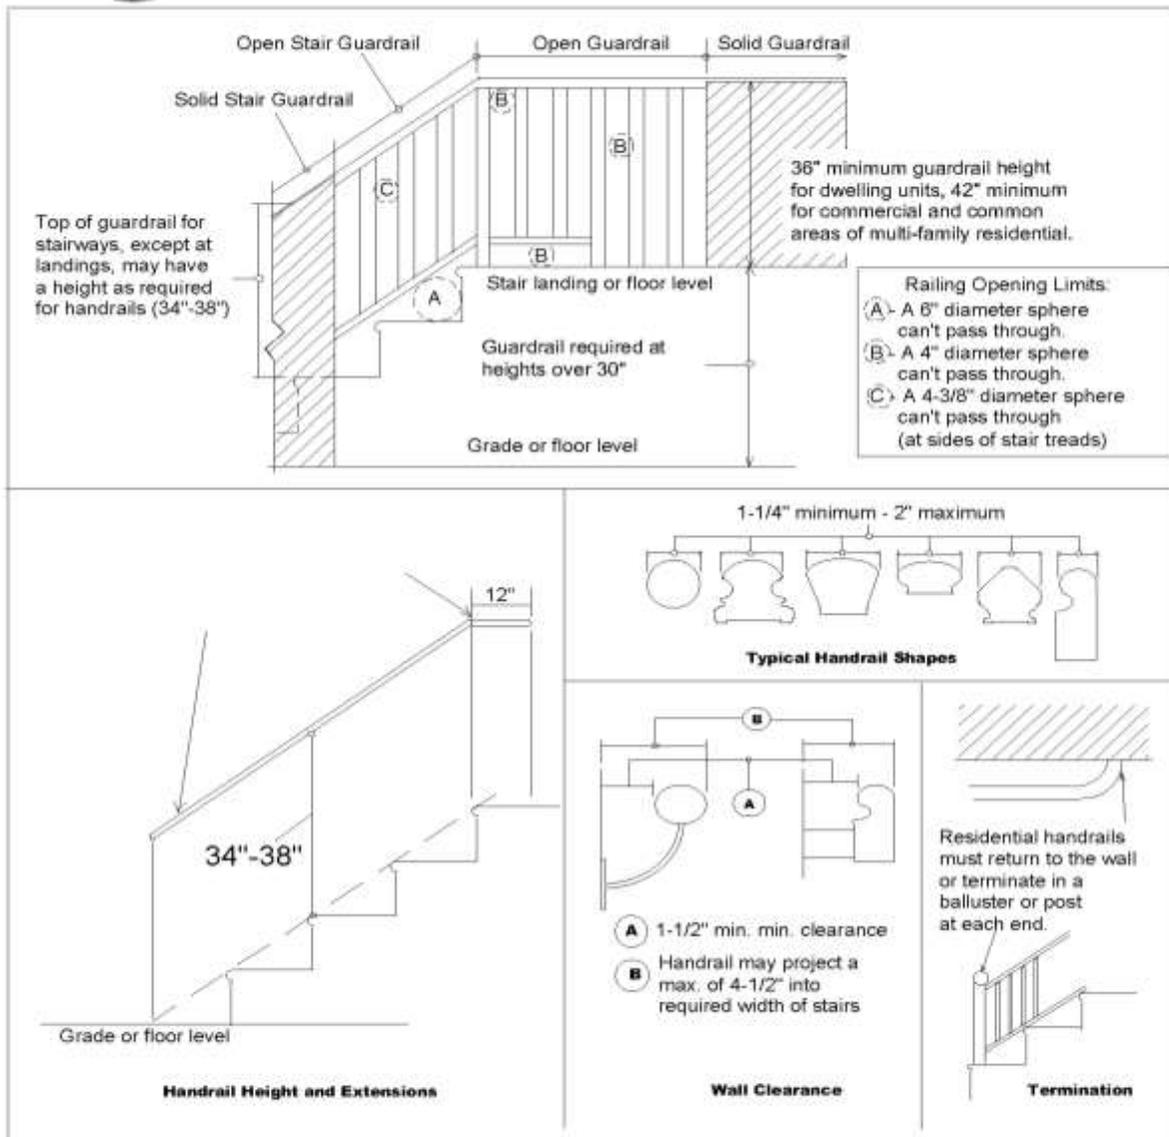

STANDARD CONSTRUCTION DETAILS EMERGENCY EGRESS/RESCUE OPENING

R310

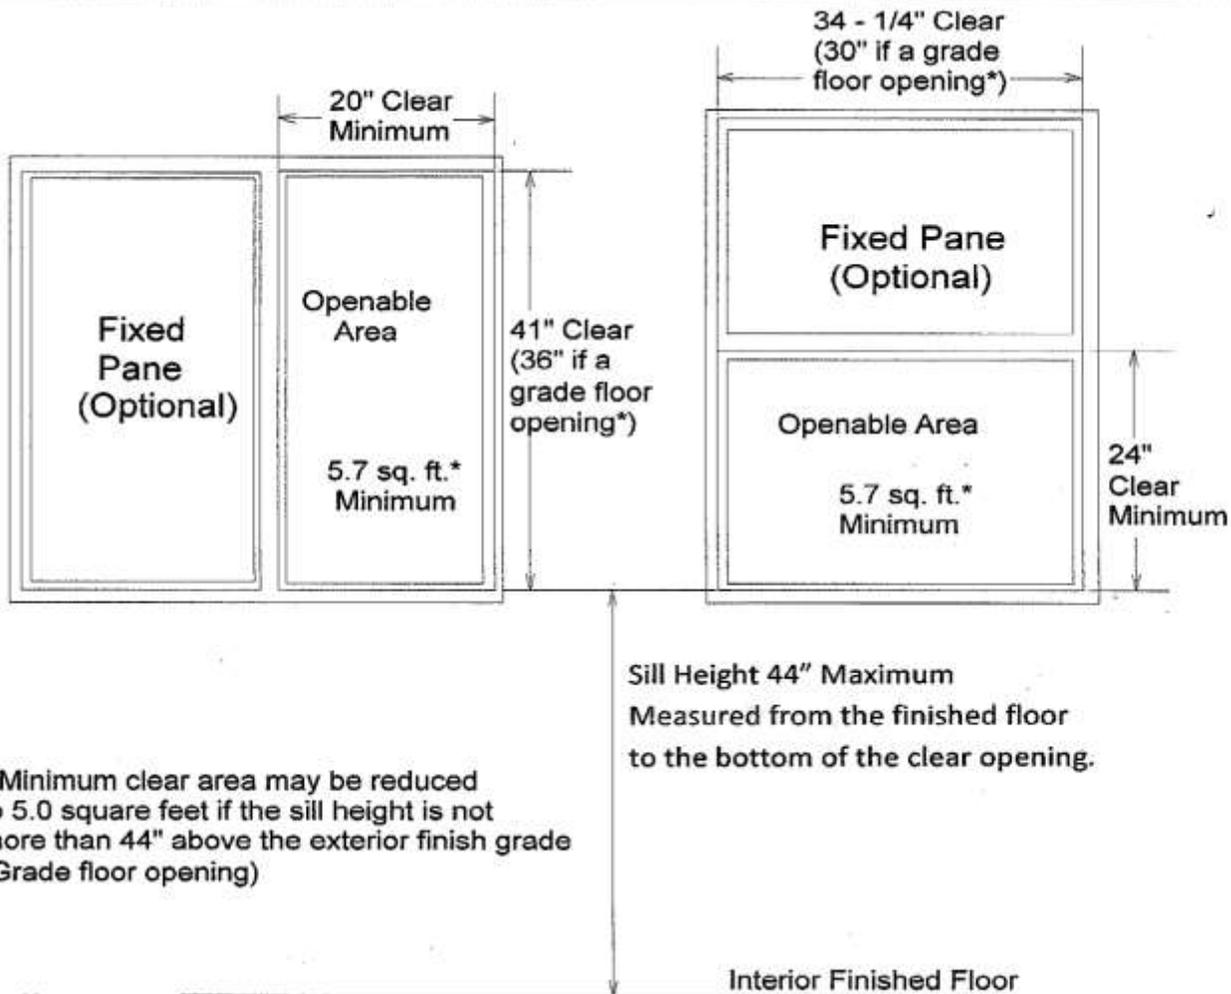

* Minimum clear area may be reduced to 5.0 square feet if the sill height is not more than 44" above the exterior finish grade (Grade floor opening)

Notes:

1. Basements in dwelling units and in every sleeping room below the fourth story shall have at least one emergency escape and rescue window or door opening directly to an approved outside location.
2. The door or window shall be openable from the inside without the use of separate tools.
3. Finishes sill height of 44" is measured from the interior finished floor level to the bottom of the clear opening of the window. A step may not be used to achieve proper height unless it complies with the code requirements as a landing.

